GENERAL NOTES

1. REFER TO T-SERIES DRAWINGS FOR TELECOM LAYOUTS.
2. IN ADDITION TO WORK SHOWN ON EY-SERIES DRAWINGS, PROVIDE DUCT-MOUNTED SMOKE DETECTORS WHERE INDICATED ON M-SERIES DRAWINGS. FOR EACH DUCT DETECTOR PROVIDE A REMOTE ALARM INDICATOR AND TEST/RESET SWITCH MOUNTED AT 54" AFF IN NEAREST CORRIDOR. PROVIDE AN ADDRESSABLE FIRE ALARM RELAY MODULE WITHIN 3' OF EACH SMOKE AND FIRE/SMOKE DAMPER AND WITHIN 3' OF AHU MOTOR STARTERS.
3. VOICE/DATA OUTLETS PLACED IN A FIRE RATED WALL SHALL MEET NEC CODE TO MAINTAIN FIRE RATING.

SHEET KEYNOTES

1. SMOKE DETECTOR SHALL ACTIVATE ELEVATOR RECALL FUNCTIONS.
2. LOCATE HEAT DETECTOR ADJACENT TO SPRINKLER HEAD.

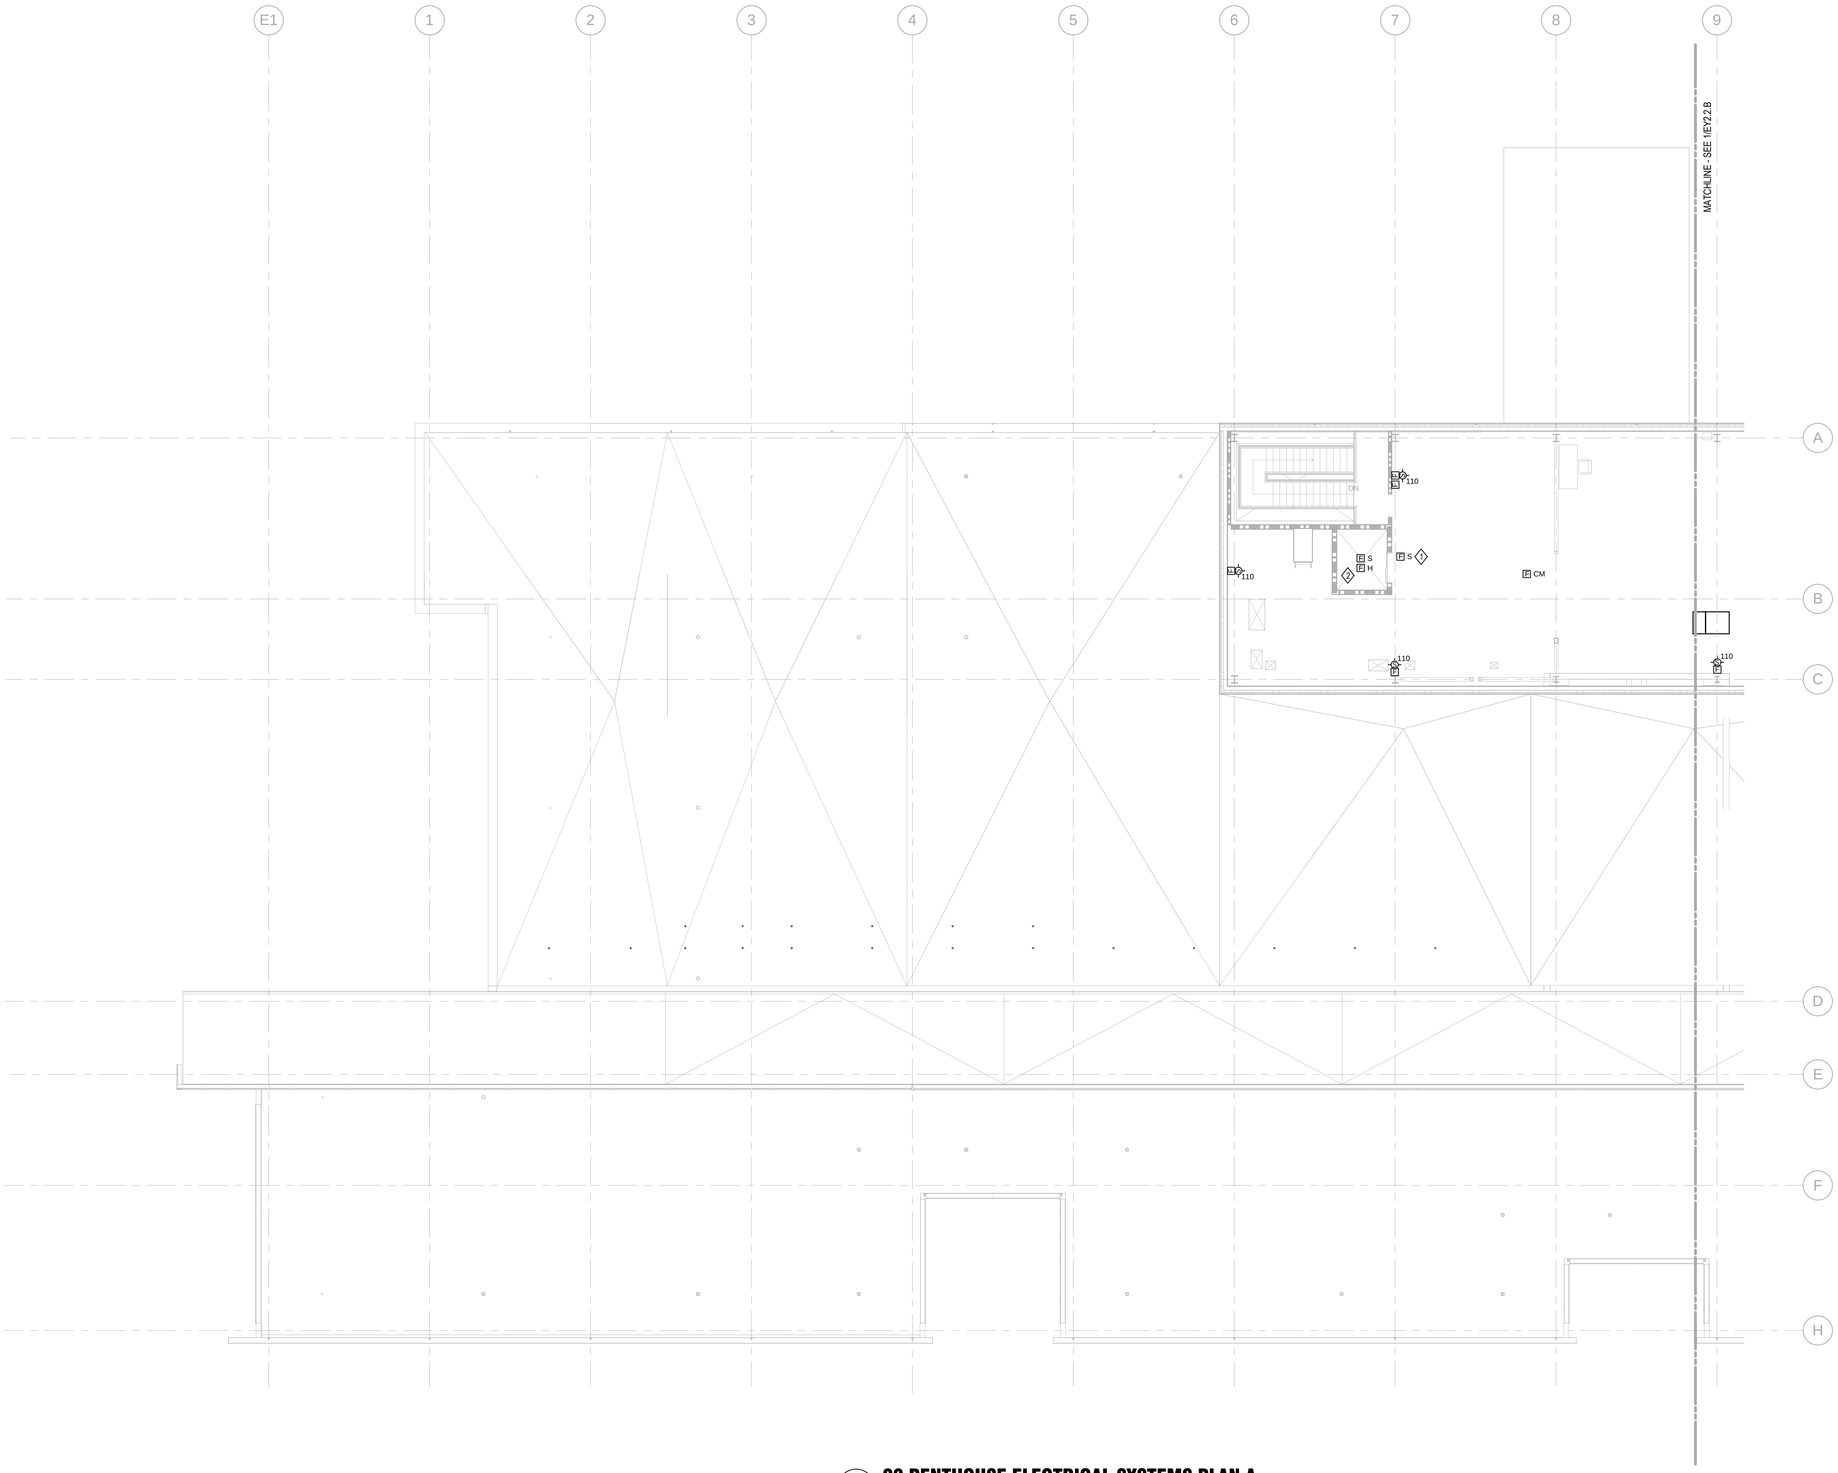

1 **02 PENTHOUSE ELECTRICAL SYSTEMS PLAN A**
1/8" = 1'-0"

SMITHGROUP
architecture engineering interiors planning
SMITHGROUP, INC
35 EAST WACKER
SUITE 2200
CHICAGO, IL 60601
T 312.641.0770
F 312.641.6728
www.smithgroup.com

JJR
landscape architecture
planning
urban design
civil engineering
environmental science
JJR, LLC
35 EAST WACKER DRIVE
SUITE 2200
CHICAGO, ILLINOIS 60601
312.641.0510 T
312.641.0668 F
www.jjr-us.com

AEI Affiliated Engineers
Affiliated Engineers, Inc.
5802 Research Park Boulevard
Madison, Wisconsin 53719
Tel 608.238.2616 Fax 608.238.2614

Thornton Tomasetti
Thornton Tomasetti, Inc.
330 N. Wabash Avenue, Suite 1500
Chicago IL 60611-7622
T 312.596.2000 F 312.596.2001

TERRA ENGINEERING LTD.
225 West Ohio Street, 4th Floor
Chicago, Illinois 60654
T:(312)467-0123 F:(312) 467-0220

SEALS AND SIGNATURES

KEYPLAN



REV. NO.	DESCRIPTION	BY	APVD	DATE
	ISSUED FOR CONSTRUCTION			07/03/12

Argonne NATIONAL LABORATORY

FMS
Facilities Management Services

PROJECT TITLE ADVANCED PROTEIN CRYSTALLIZATION FACILITY, ARGONNE NATIONAL LABORATORY

PROJECT NO 08541-00

DRAWING TITLE

02 PENTHOUSE ELECTRICAL SYSTEMS PLAN A

DESIGNED DLW	A/E CADD FILE EY2.2.A	FACILITY NO(S)
DRAWN DLW	A/E DWG. NO. EY2.2.A	
CHECKED BRB	CAD NO:	
PROJECT MANAGER ANL - JESSE ADAMS DATE - 04/26/11	DWG STATE	
	BIND ORDER	
FACILITY DOCUMENT NUMBER J446-101-W-		REV. NO. EY2.2.A

Plot Date: 6/29/2012 1:22:40 PM